



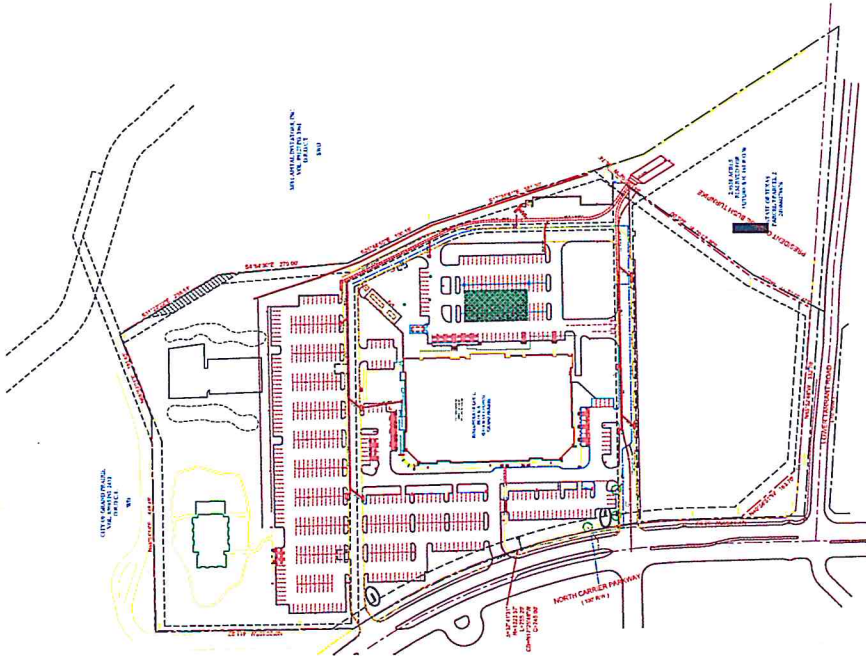

SITE PLAN

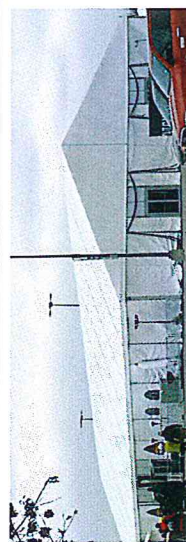

ELEVATIONS

General Notes:

Tent Duration is 4-6 months
Tent Seating to accommodate 500 Seats


- 1) Permit will be submitted with the City of Grand Prairie
- 2) Engineer's design on Tent structure, flooring system and anchoring will be provided in the permit submittal
- 3) Engineer's report after install stating structure was installed per design (As built Letter) will be provided to the City.
- 4) A Structural Engineer will re-certify the tent monthly and provide documentation of the inspection.
- 5) Electrical shall be permitted and inspected and shall comply with the 2008 NEC
- 6) Exits and exit signs shall be installed according to the 2009 IBC and IFC
- 7) Emergency lighting shall be installed according to 2009 IBC
- 8) Fire Extinguishers shall be installed per 2009 IBC and IFC
- 9) Temporary stand-pipe is to be provided at the tent per 2404.13 Fire protection equipment. Fire hose lines, water supplies and other auxiliary fire equipment shall be maintained at the site in such numbers and sizes as required by the fire code official.
- 10) Generators shall maintain a separation of 20' from the tent per 2404.19 Separation of generators. Generators and other internal combustion power sources shall be separated from tents or membrane structures by a minimum of 20 feet (6096 mm) and shall be isolated from contact with the public by fencing, enclosure or other approved means.
- 11) Standby personnel to be provided during events per 2404.20 Standby personnel. When, in the opinion of the fire code official, it is essential for public safety in a tent or membrane structure used as a place of assembly or any other use where people congregate, because of the number of persons, or the nature of the performance, exhibition, display, contest or activity, the owner, agent or lessee shall employ one or more qualified persons, as required and approved, to remain on duty during the times such places are open to the public, or when such activity is being conducted. (Discretion of Fire Marshall's office)
- 12) Crowd Managers to be provided during events per 2404.20.2 Crowd managers. There shall be trained crowd managers or crowd manager/supervisors at a ratio of one crowd manager/supervisor for every 250 occupants, as approved.

RECEIVED

APR 29 2015

PLANNING DEPARTMENT

CASE NUMBER
#S150506

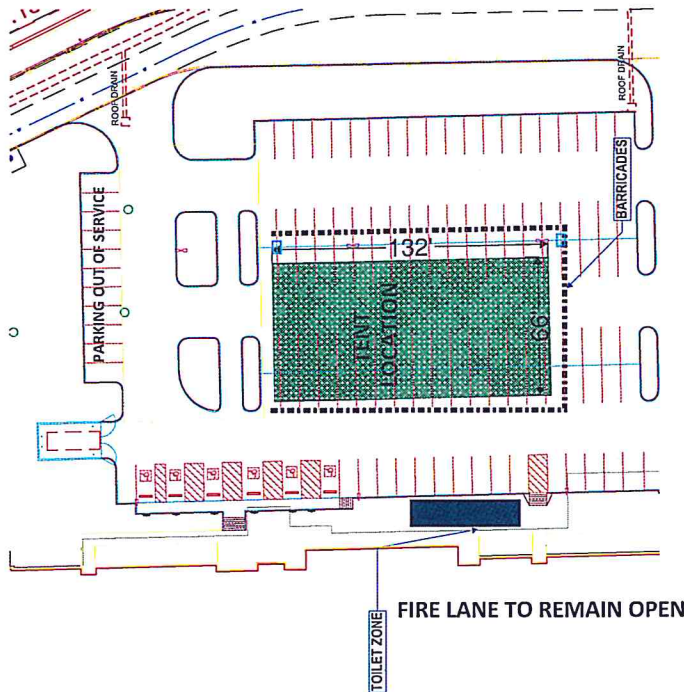

VICINITY PLAN

NOTE: PARKING AT TENT AND BARRICADE LOCATIONS ARE OUT OF SERVICE

GATEWAY CHURCH
GRAND PRAIRIE CAMPUS - TENT
LOCATION
GRAND PRAIRIE, TEXAS

TEMPORARY TENT
STRUCTURE
SUBMITTAL

CURRENT SUBMISSION/REVISION	
No.	Revision/Issue
1	04/22/15

SHEET TITLE
SITE PLAN
A1.0

Date	04/22/15
Drawn	
Scale	

CONTACT:
BRAD HENDERSON
Email: brad.henderson@gatewaystaff.com
Phone: (817) 552-7592